



150002281904



(2015)建材质监认字(17)号



中国认可
国际互认
检测
TESTING
CNAS L1449

检 验 报 告

TEST REPORT

报告编号: JS2020GD0794



样品名称: PVC-O管材

Sample Name

委托单位: 河北建投宝塑管业有限公司

Applicant

检验类别: 委托检验

Test Type

国家建筑材料工业建筑围护材料及管道产品质量监督检验测试中心

National Building Material Industry Enclosure Material and Pipeline Production Quality Supervision and Test Center

检验检测专用章



检验报告 (TEST REPORT)

报告编号№: JS2020GD0794

第 1 页 共 2 页

委托单位 Applicant	河北建投宝塑管业有限公司	检验类别 Test Type	委托检验
受检单位 Inspected Entity	---	委托日期 Consign Date	2020年04月28日
工程名称及使用部位 Engineering Name and Application Part	---	来样日期 Accept Date	2020年04月28日
样品名称 Sample Name	PVC-0管材	样品数量 Sample Quantity	1m×6根
型号/规格 Type/Specification	dn110, SDR37, PN16, 450级	样品等级 Grade	---
生产单位 Manufacturer	河北建投宝塑管业有限公司	样品状态 Sample State	完好
生产日期/批号 Production Date/Lot №	---	商标 Trade Mark	宝塑
检验依据 Ref Documents	详见数据页		
判定依据 Decision Documents	CJ/T 445-2014 《给水用抗冲抗压双轴取向聚氯乙烯(PVC-0)管材及连接件》		
检验项目 Test Item	外观, 不透光性, 落锤冲击试验, 环刚度, 拉伸强度, 耐静液压性能 (20℃, 10h), 几何尺寸		
检验结论 Test Conclusion	<p>该样品经检验, 所检项目符合CJ/T 445-2014 《给水用抗冲抗压双轴取向聚氯乙烯(PVC-0)管材及连接件》的指标要求。</p> <p>签发日期: 2020年05月06日 Issued by (Stamp)</p>		
附注 Remarks	本检验结果仅对来样负责。检验检测专用章		



批准: 李延军
Approved by:

审核: 周峰
Inspected by:

主检: 范中举
Tested by:

检验报告 (TEST REPORT)

报告编号№: JS2020GD0794

第 2 页 共 2 页

序号	检验项目		检验依据	指标要求	检验结果	单项判定
1	外观		CJ/T 445-2014	管材的内外表面应光滑、平整,无裂口、凹陷和其他影响管材性能的表面缺陷。管材不应含有可见杂质,管材端面应切割平整,并与轴线垂直。	管材的内外表面光滑、平整,无裂口、凹陷和其他影响管材性能的表面缺陷。管材无可见杂质,管材端面切割平整,并与轴线垂直。	符合
2	不透光性		GB/T 21300-2007	透光率 $\leq 0.2\%$	$< 0.1\%$	符合
3	几何尺寸, mm	平均外径	GB/T 8806-2008	110.0~110.4	110.1~110.2	符合
		壁厚	GB/T 8806-2008	≥ 3.1	3.2~3.4	符合
4	耐静液压性能(20℃, 10h)		GB/T 6111-2018	环应力60MPa, 无破裂、无渗漏	无破裂、无渗漏	符合
5	落锤冲击试验		CJ/T 445-2014	$\leq 10\%$	$\leq 10\%$	符合
6	环刚度, kN/m^2		GB/T 9647-2015	≥ 7.8	8.1	符合
7	拉伸强度, MPa		GB/T 8804.2-2003	≥ 48	48	符合

检测地址: 北京市房山区窦店镇亚新路17号;
联系电话: 4000330789、010-60350462-8053。

(本页以下空白)

***** 结 束 *****

**注意事项
NOTICE**

1.报告无“检验检测专用章”或检验单位公章、骑缝章无效。

Test report is invalid without the "special seal for test report" or that of test department and perforated rider stamp on it.

2.复制报告未重新加盖“检验检测专用章”或检验单位公章无效。

Duplication of test report is invalid without the "special seal for test report" or that of test department re-stamped on it.

3.报告无主检、审核、批准签字无效。

Test report is invalid without the signatures of the persons for chief test, verification and approval.

4.报告涂改无效。


Test report is invalid if altered.

5.对检验报告若有异议，应于收到报告之日起十五日内向检验单位提出。

Any dissidence about the test report should be brought forward to the test department within 15 days from the date of receiving the test report.

6.一般情况，委托检验仅对来样负责。

In general, for entrusted tests the responsibilities are undertaken for the delivered samples only.

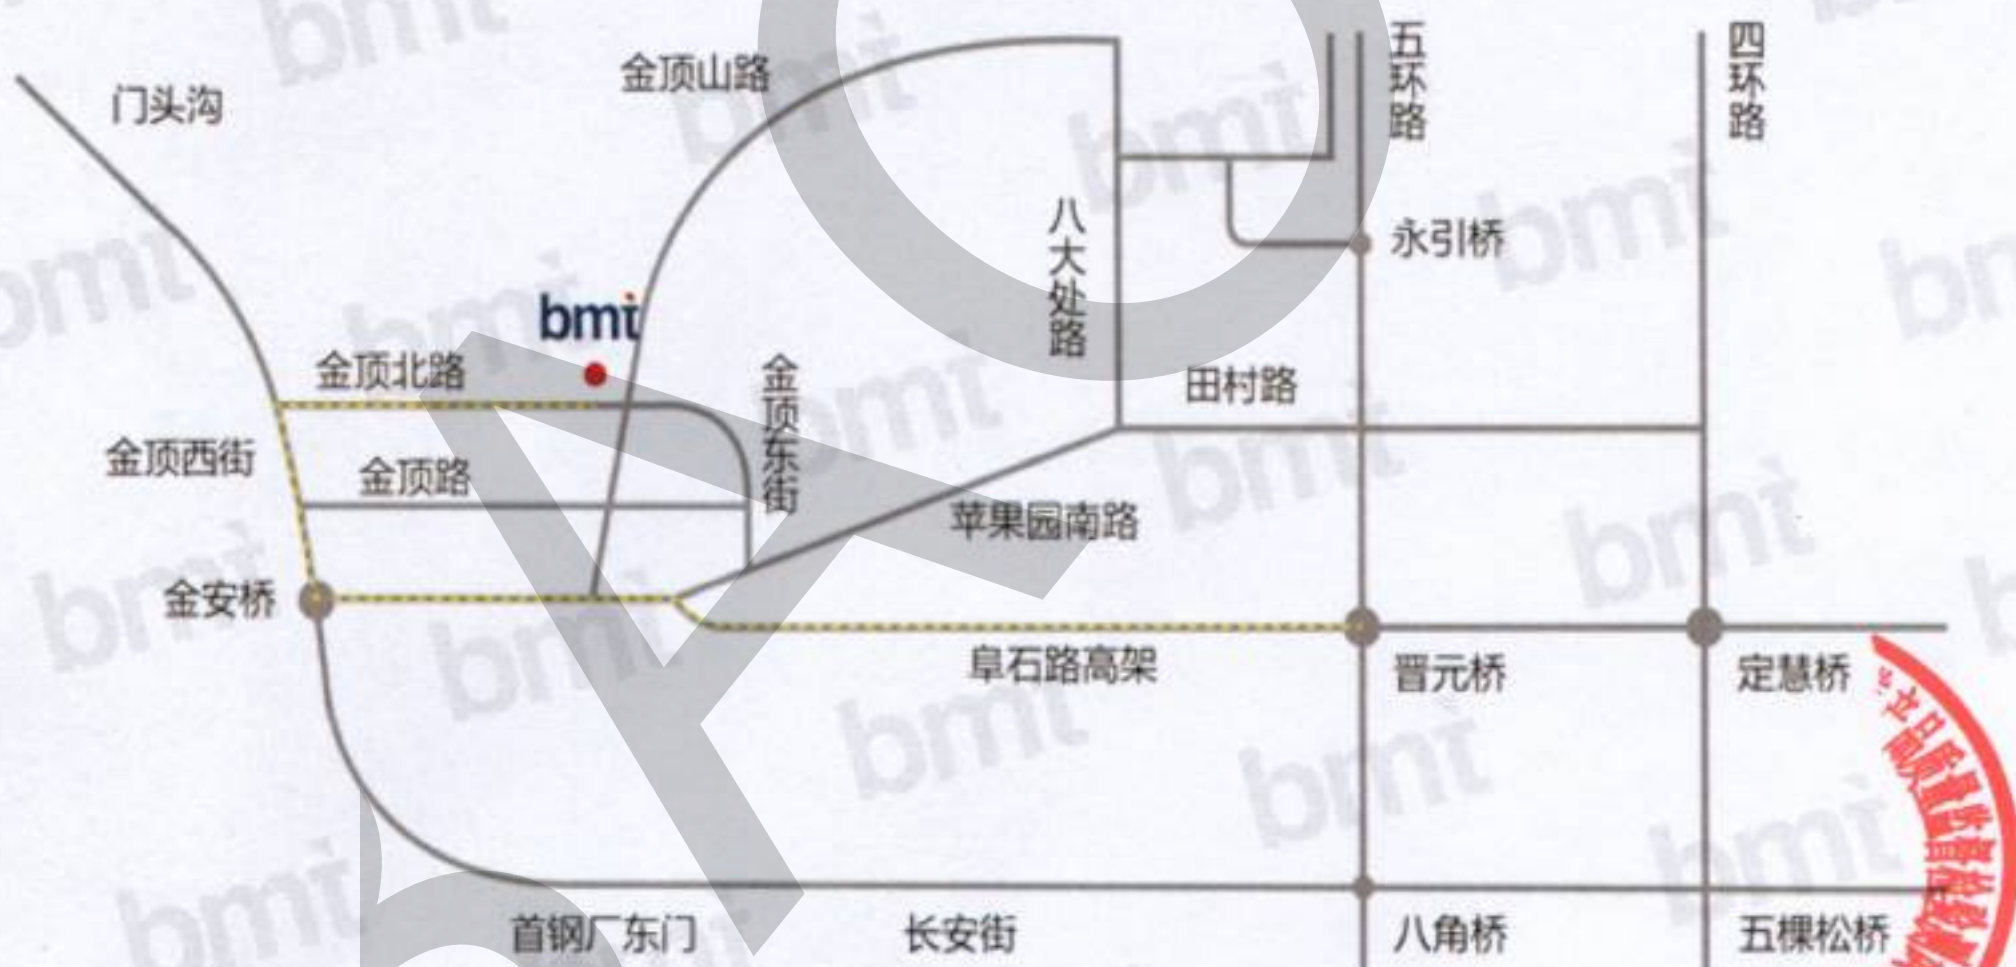

路线备注：沿阜石路高架向西行驶，见金顶西街出口进入辅路，金安桥下右转，第二个丁字路口（第一个红绿灯）右转，直行600米路北。



地址：北京市石景山区金顶北路69号(100041)

Add: No.69 JinDing North Road, Shijingshan District, Beijing, China 100041

网址(Web) : www.bmtbj.cn

电话(Tel): 010-88724984 88749821

传真(Fax): 010-88715189

客服热线 : 400-0330-789